


SECTION A-A

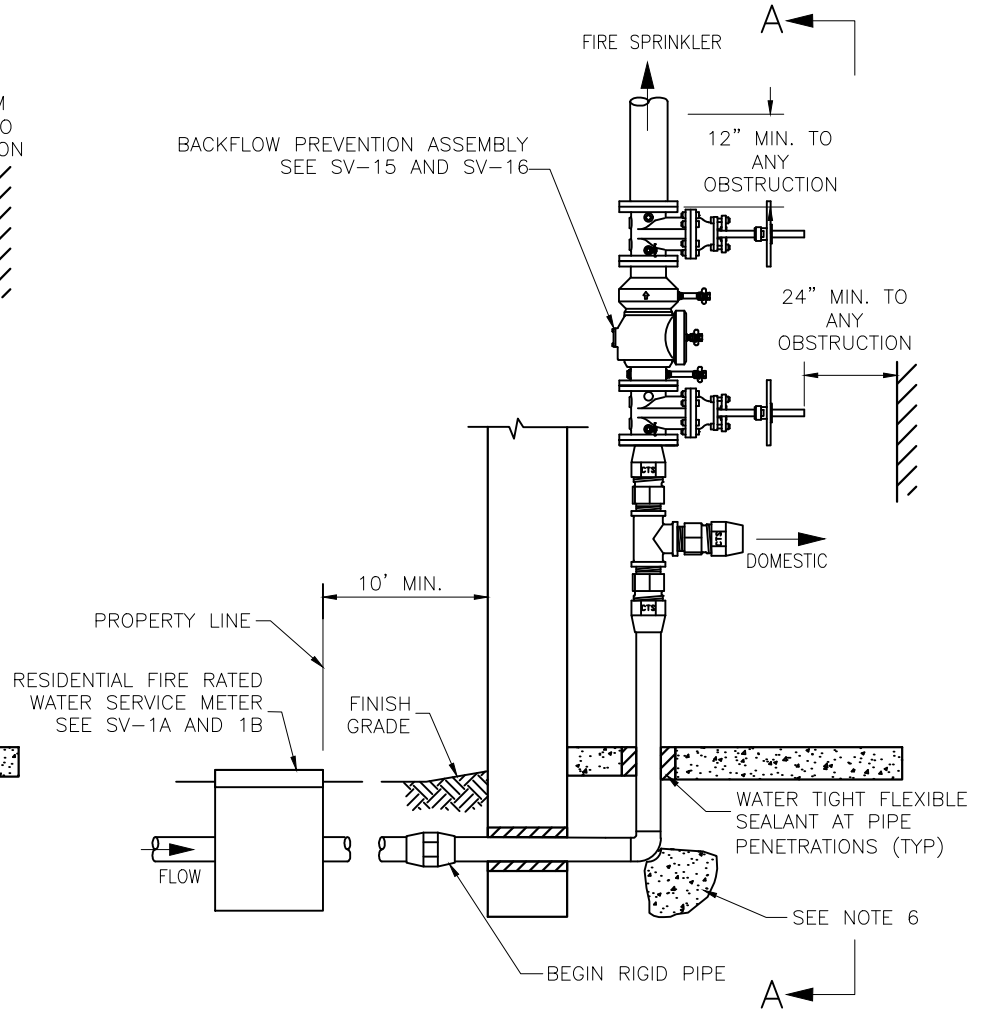

SECTION VIEW

NOTES:

1. STOP AND WASTE VALVES ARE NOT TO BE USED BETWEEN THE METER AND THE BACKFLOW PREVENTION ASSEMBLY.
2. ELECTRICAL SUPPLY SOCKETS MUST BE AWAY FROM WATER RELIEF PORT AND TEST COCKS.
3. BACKFLOW PREVENTION ASSEMBLY TYPE TO BE DETERMINED PER NAC 445A AND SVGID REQUIREMENTS.
4. ALL PIPING SHALL BE NSF 14 OR NSF 61 CERTIFIED. PROVIDE DIAELECTRIC INSULATION KITS BETWEEN ALL DISSIMILAR MATERIALS.
5. INSPECTION BY LOCAL BUILDING DEPARTMENT AND/OR FIRE DEPARTMENT IS REQUIRED BEFORE METER IS SET.
6. MINIMUM DIMENSIONS FOR THE THRUST BLOCK BEARING AREAS FOR PIPE 2" AND SMALLER SHALL BE 8" X 8" AND 12" IN DEPTH. REFERENCE SV-7 FOR CONCRETE REQUIREMENTS AND OTHER PIPE SIZES.
7. SVGID MUST APPROVE THE USE OF ANY INTERIOR MOUNTED BACKFLOW ASSEMBLIES.